


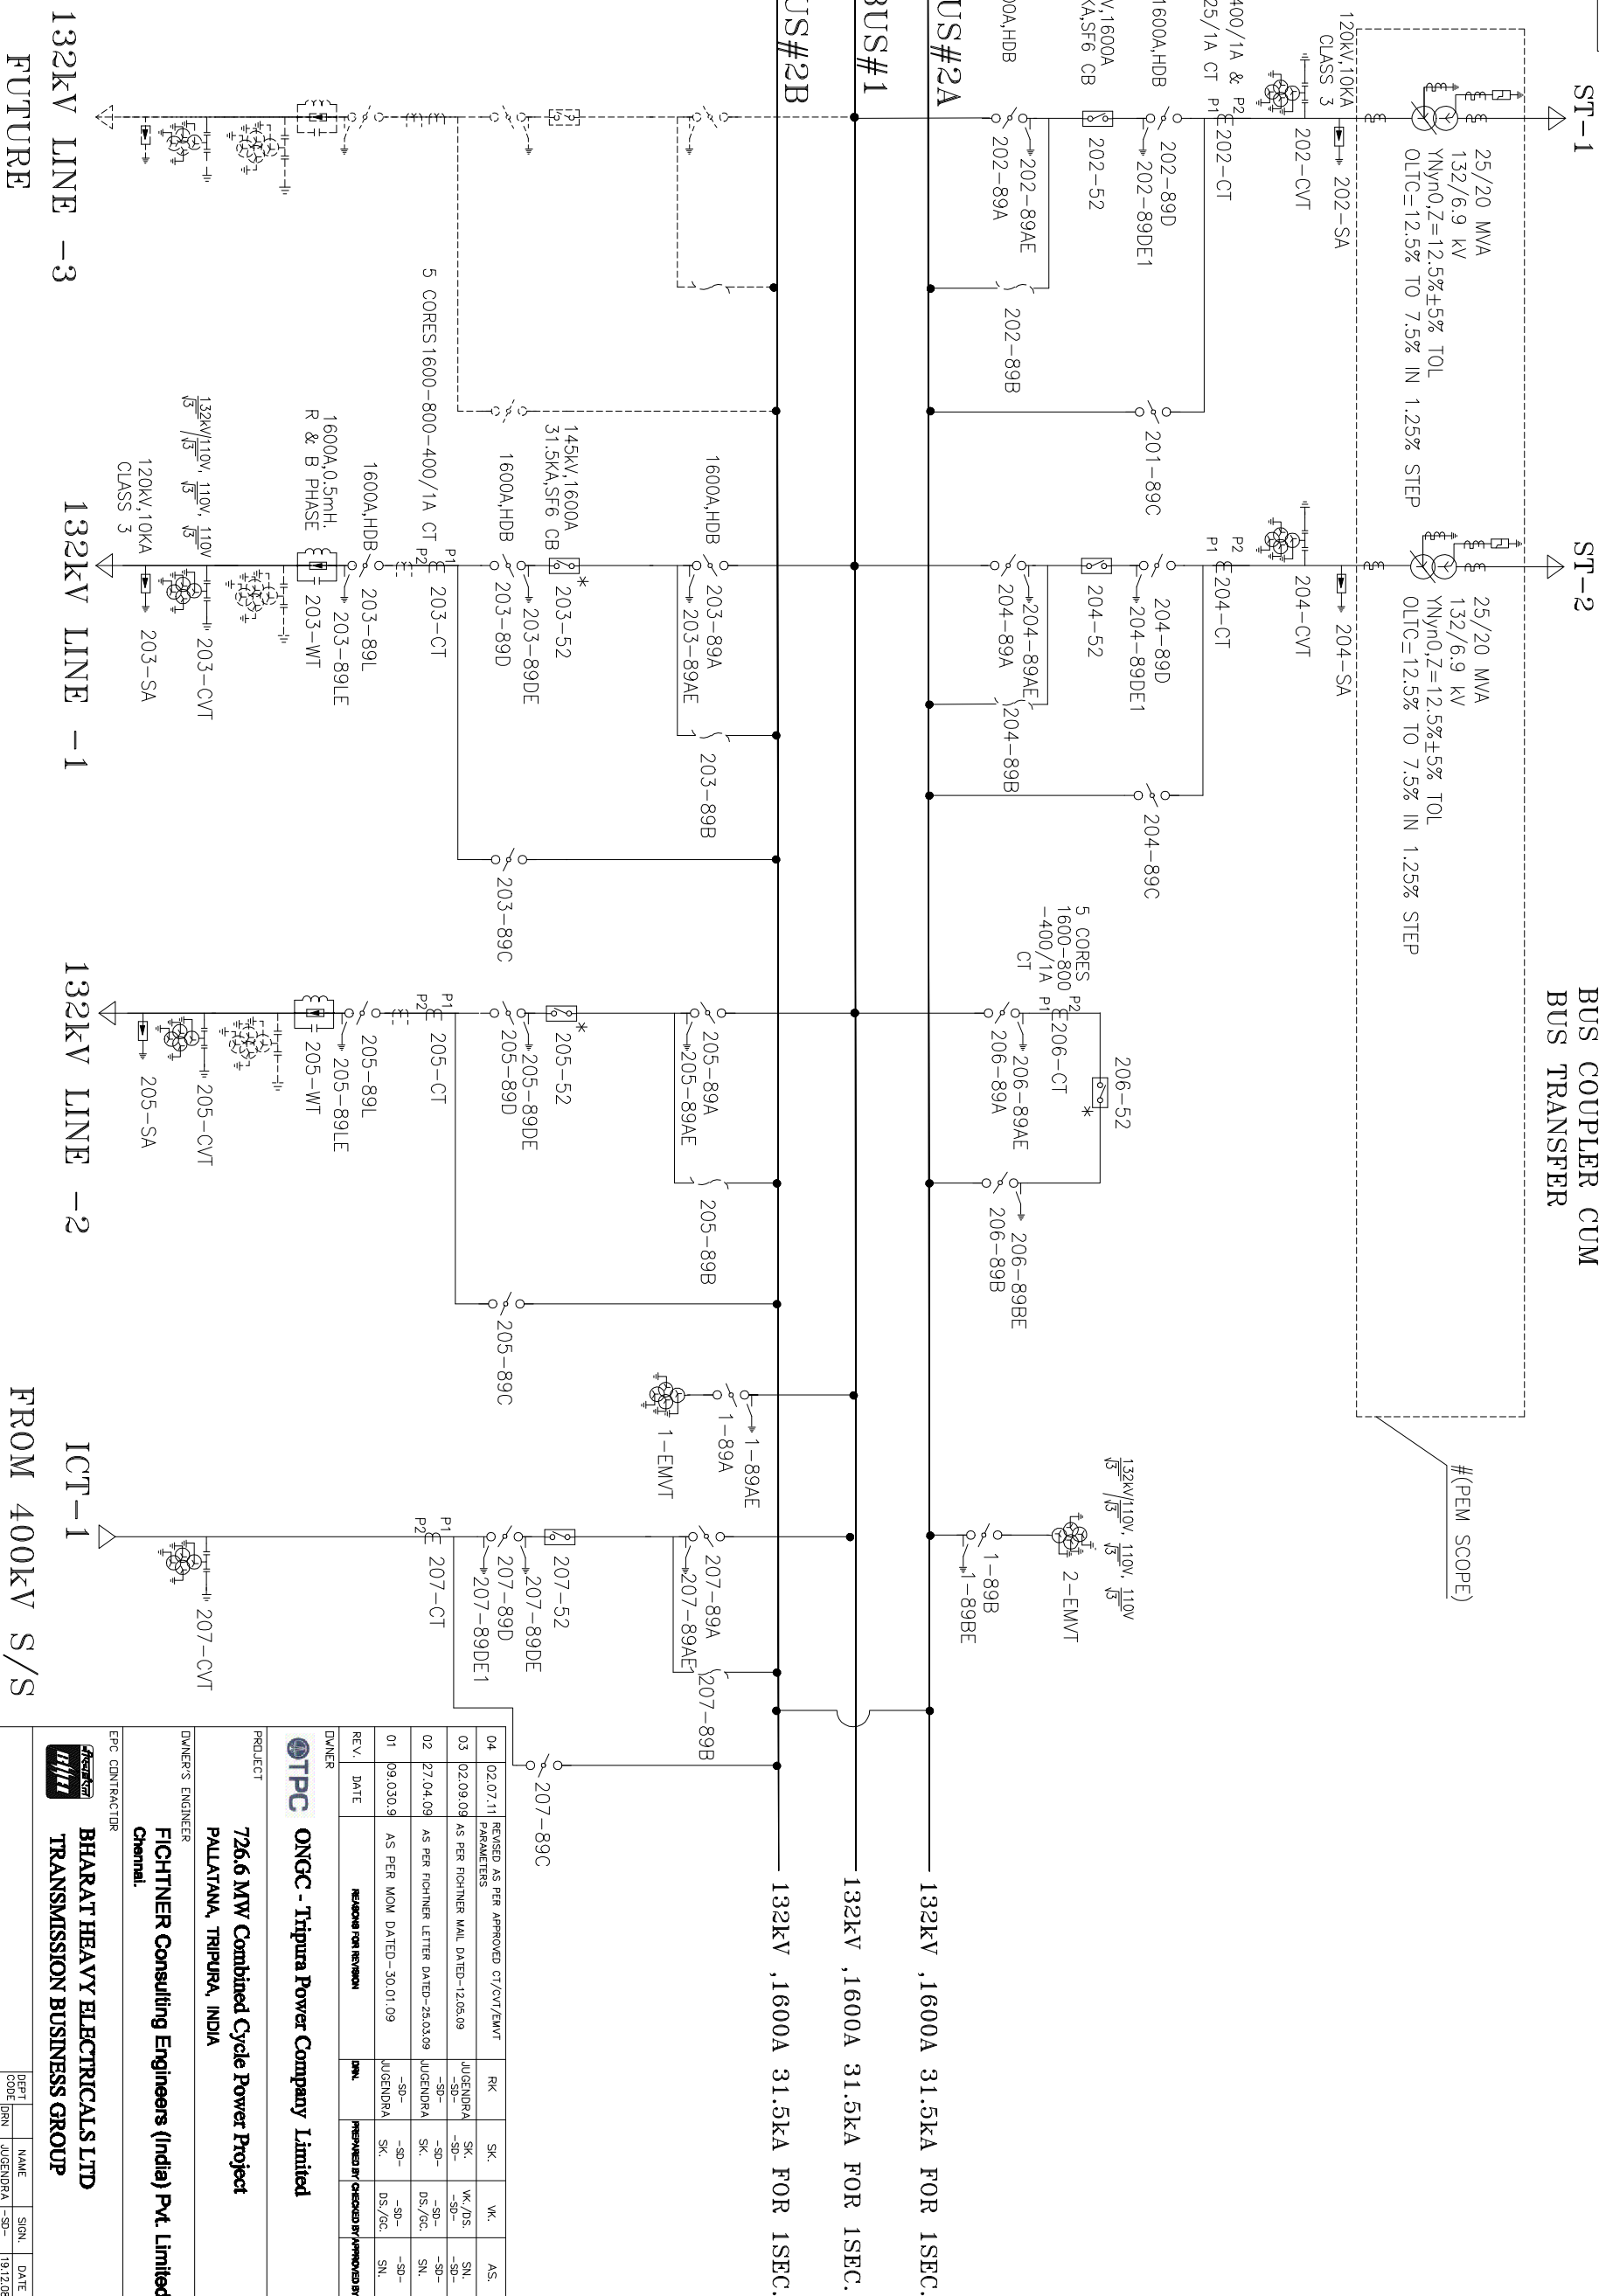

BUS COUPLER CUM  
BUS TRANSFER

REV.	DATE	REASON FOR REVISION	APPROVED BY	DESIGNED BY	CHECKED BY	DATE
04	02.07.11	REVISED AS PER APPROVED CIV/ENV/EMT PARAMETERS	RK	SK.	WK.	AS
03	02.09.09	AS PER FIGHTER MAIL DATED-12.05.09	JUGENDRA -50-	SK.	WK./DS.	SN. -50-
02	27.04.09	AS PER FIGHTER LETTER DATED-25.03.09	JUGENDRA -50-	SK.	DS./G.C.	SN. -50-
01	09.03.09	AS PER MOM DATED-30.01.09	JUGENDRA -50-	SK.	DS./G.C.	SN. -50-

 <b>ONGC - Tripura Power Company Limited</b>
PROJECT
<b>726.6 MW Combined Cycle Power Project</b> <b>PALATANA, TRIPURA, INDIA</b>
OWNER'S ENGINEER
<b>FICHTNER Consulting Engineers (India) Pvt. Limited</b> <b>Chennai.</b>
EPC CONTRACTOR
 <b>BHARAT HEAVY ELECTRICALS LTD</b> <b>TRANSMISSION BUSINESS GROUP</b>

DEPT	NAME	SIGN	DATE
DRN	JUGENDRA	-SD-	19.12.06
DESN	SK	-SD-	19.12.06
CHD	DS/GC	-SD-	19.12.06
APPD	SN	-SD-	19.12.06